


C-900/905 Water Pipe

Scope: Unplasticized Polyvinyl Chloride Municipal Water Pipe from compound with a cell classification 12454 as defined in ASTM Standard D-1784.

Pipe: All pipe shall meet the requirements of AWWA C-900, CAN/CSA-B137.3 and BNQ NQ3624-250 Standards, as indicated, for potable water transmission mains and for fire protection systems.

Our pipe meets National Sanitation Foundation Standard #61 for plastic piping system components and related materials. The gasketed joint shall meet the requirements of ASTM D-3139, and the joint gasket shall conform to ASTM F-477. Pipe shall be furnished in laying lengths of 20' (+/- 1"). Other lengths may be available upon request.

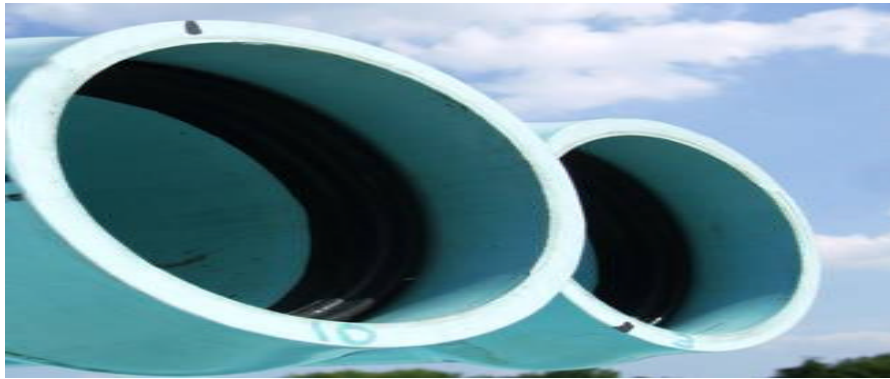

Technical Information

- Sizes/Diameters available from 4" – 24"
- Length available 18'(feet) or 20'(feet)
- Minimum wall thickness of DR(Dimension Ratio): 18 / 21 / 25
- Pressure Rating (PSI) 235 / 200 / 165
- Approved by UNI-BELL/AWWA/NSF/ASTM/CSA

* We can supply up to 48" with different option of DR(Dimension of Ratio) upon request.

